




HYDRANAL™ CRM Water Standards for Karl Fischer Titration

Honeywell /Crescent is pleased to present a new generation of Hydranal Certified Reference Material (CRM) Water Standards. These CRMs are produced and certified under ISO Guide 34 in combination with ISO/IEC 17025, using volumetric or coulometric Karl Fischer Titration. The products are supplied with a printed certificate containing a certified value, comprehensive documentation, proper uncertainty calculation, lot-specific values, expiration dates, and storage information.

Karl Fischer Titration is the most widely used method for measuring water content in products and substances. Today, highly accurate measurements are a requirement for many end users. This change, which is driven by regulatory authorities, is forcing many laboratories to acquire ISO/IEC 17025 accreditation. To help laboratories meet this requirement and obtain highly-accurate measurements and traceability in their results, lab managers can now turn to the new product line of Hydranal CRMs.


Hydranal CRMs serve as a reference point. They are traceable to high-purity materials of well-established purity and/or SI units. Additionally they are verified against internationally accepted standards from national metrological institutes such as NIST (National Institute of Standards & Technology, USA) or NMIJ (National Metrology Institute of Japan). In addition to traceability to accepted references, Hydranal CRMs have a well-defined mass fraction and highly accurate measurement of uncertainty which can be found in the Certificate of Analysis (CoA).

Hydranal CRMs are tested under ISO/IEC 17025 and comply with ISO Guide 34 requirements.

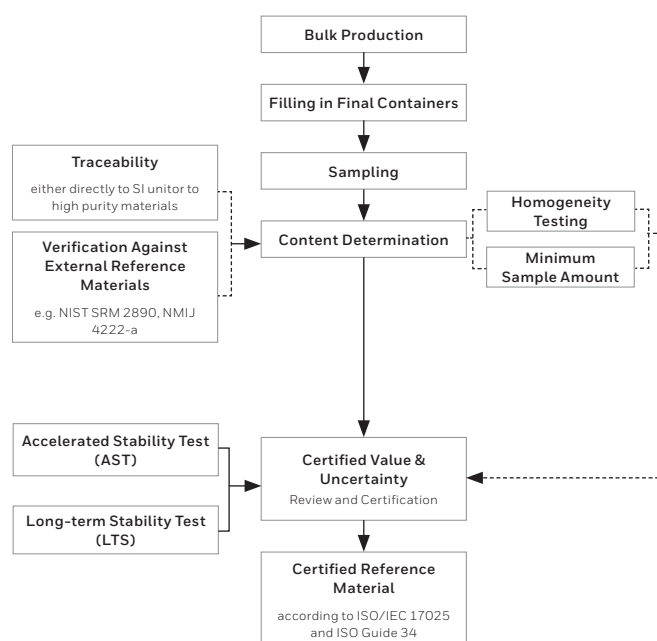

General flowchart for the certification process of Hydranal™ CRM

PRODUCT NUMBER	PRODUCT NAME	DESCRIPTION	PACKAGING
34424	HYDRANAL-CRM Sodium Tartrate Dihydrate	Solid CRM standard, water content ~ 15.66%	10 g
34425	HYDRANAL-CRM Water Standard 10.0	Liquid CRM standard, water content 10.0 mg/g = 1.0%	10 x 8 mL
34426	HYDRANAL-CRM Water Standard 1.0	Liquid CRM standard, water content 1.0 mg/g = 0.1%	10 x 4 mL

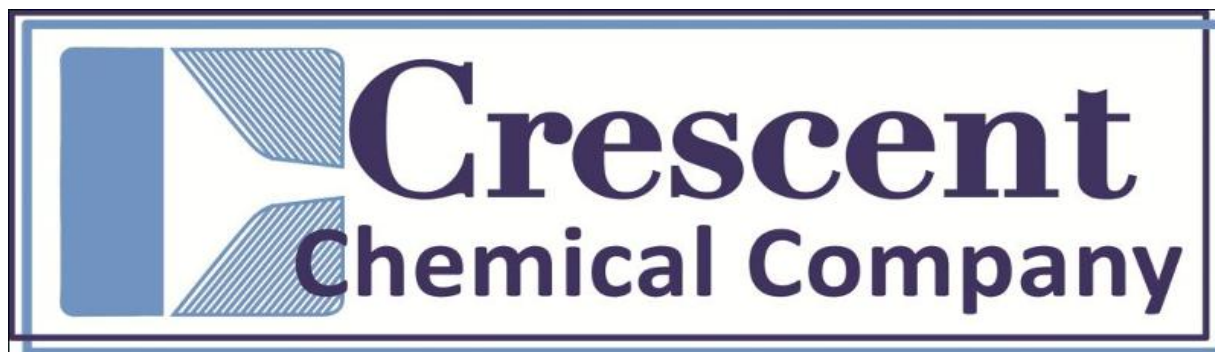

To learn more about Hydranal, visit

crescentchemical.com

United States & Canada

Crescent Chemical Co., Inc.

2 Oval Drive
Islandia, NY 11749

631-348-0333
800-877-3225

fax 631-348-0913
sales@creschem.com

All statements and information provided herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of our products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. User assumes all liability for use of the information and results obtained.



Fluka and Hydranal are trademarks of Honeywell
Specialty Chemicals Seelze GmbH.

HYD-001-0006-ENG | 01/17
© 2017 Honeywell International Inc. All rights reserved.

Honeywell